


The System



SONOMACOOOL

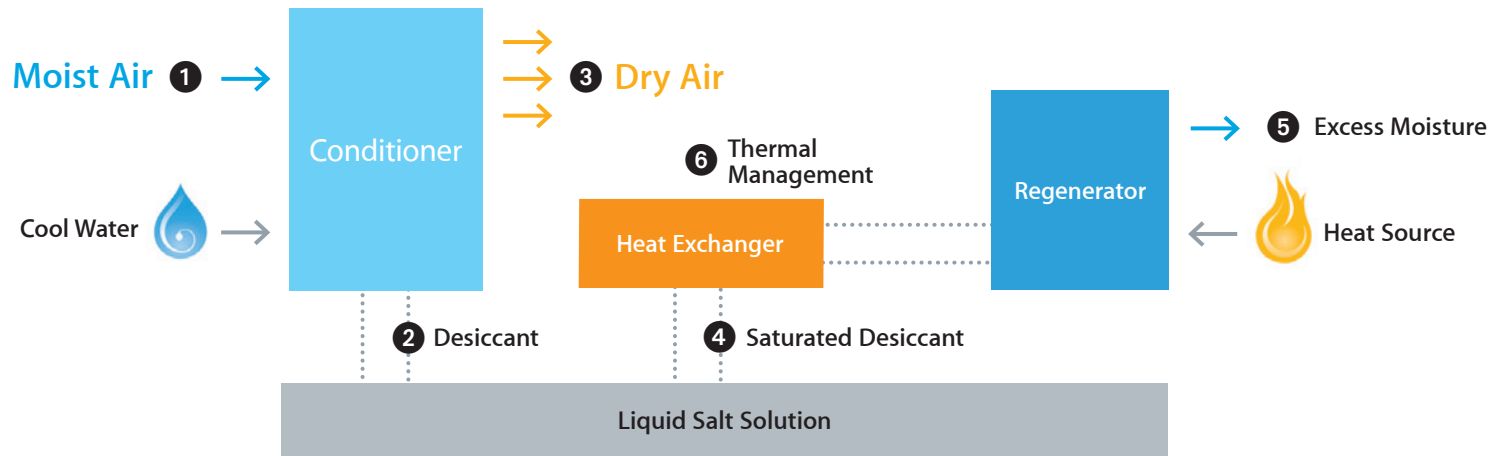

1

Outside, humid air is drawn into the Conditioner.

2

Liquid desiccant (salt) removes the moisture; water cools the Conditioner.

3

Dried process air is released to the building's cooling unit.

4

Saturated desiccant is sent to the Regenerator.

5

Heat dries the desiccant. Air flows through the Regenerator, carrying off excess moisture.

6

Heat Exchanger reduces energy consumption throughout the system.

Efficiency matters.

PAXSTREAMLINE